


Notes:

1. This drawing is for 'Dimensional Information Only', It is essential that this drawing is read in conjunction with the 'Installation Guidelines' supplied with the unit. (Copies available from our sales department).
2. All Pipe connections are ϕ 110.0mm PVCu.
3. All units require appropriate 'Cover' & 'Frame' to suit site loadings (standard pedestrian duty cover supplied).
4. PST= Primary Settlement Tank
5. BIOZONE= Biological Treatment Zone Including media and diffuser.
6. FST= Final Settlement Tank.
7. Blower assembly mounted inside turret.
8. Control Panel to be mounted in a visible area (Control Panel supplied inside unit for transport).
9. Green Single Control Panel will be supplied with standard units.
10. System requires suitable ventilation using vent ducts provided.

Unit Ref	A' (mm)	B' (mm)	C' (mm)	D' (mm)	E' (mm)	F' (mm)	G' (mm)	Unit Weight (Kgs)
450mm Invert	450	550	2720	1530	1727	300	270	280
750mm Invert	750	850	2720	1530	2027	600	570	295
1000mm Invert	1000	1100	2720	1530	2277	850	820	305

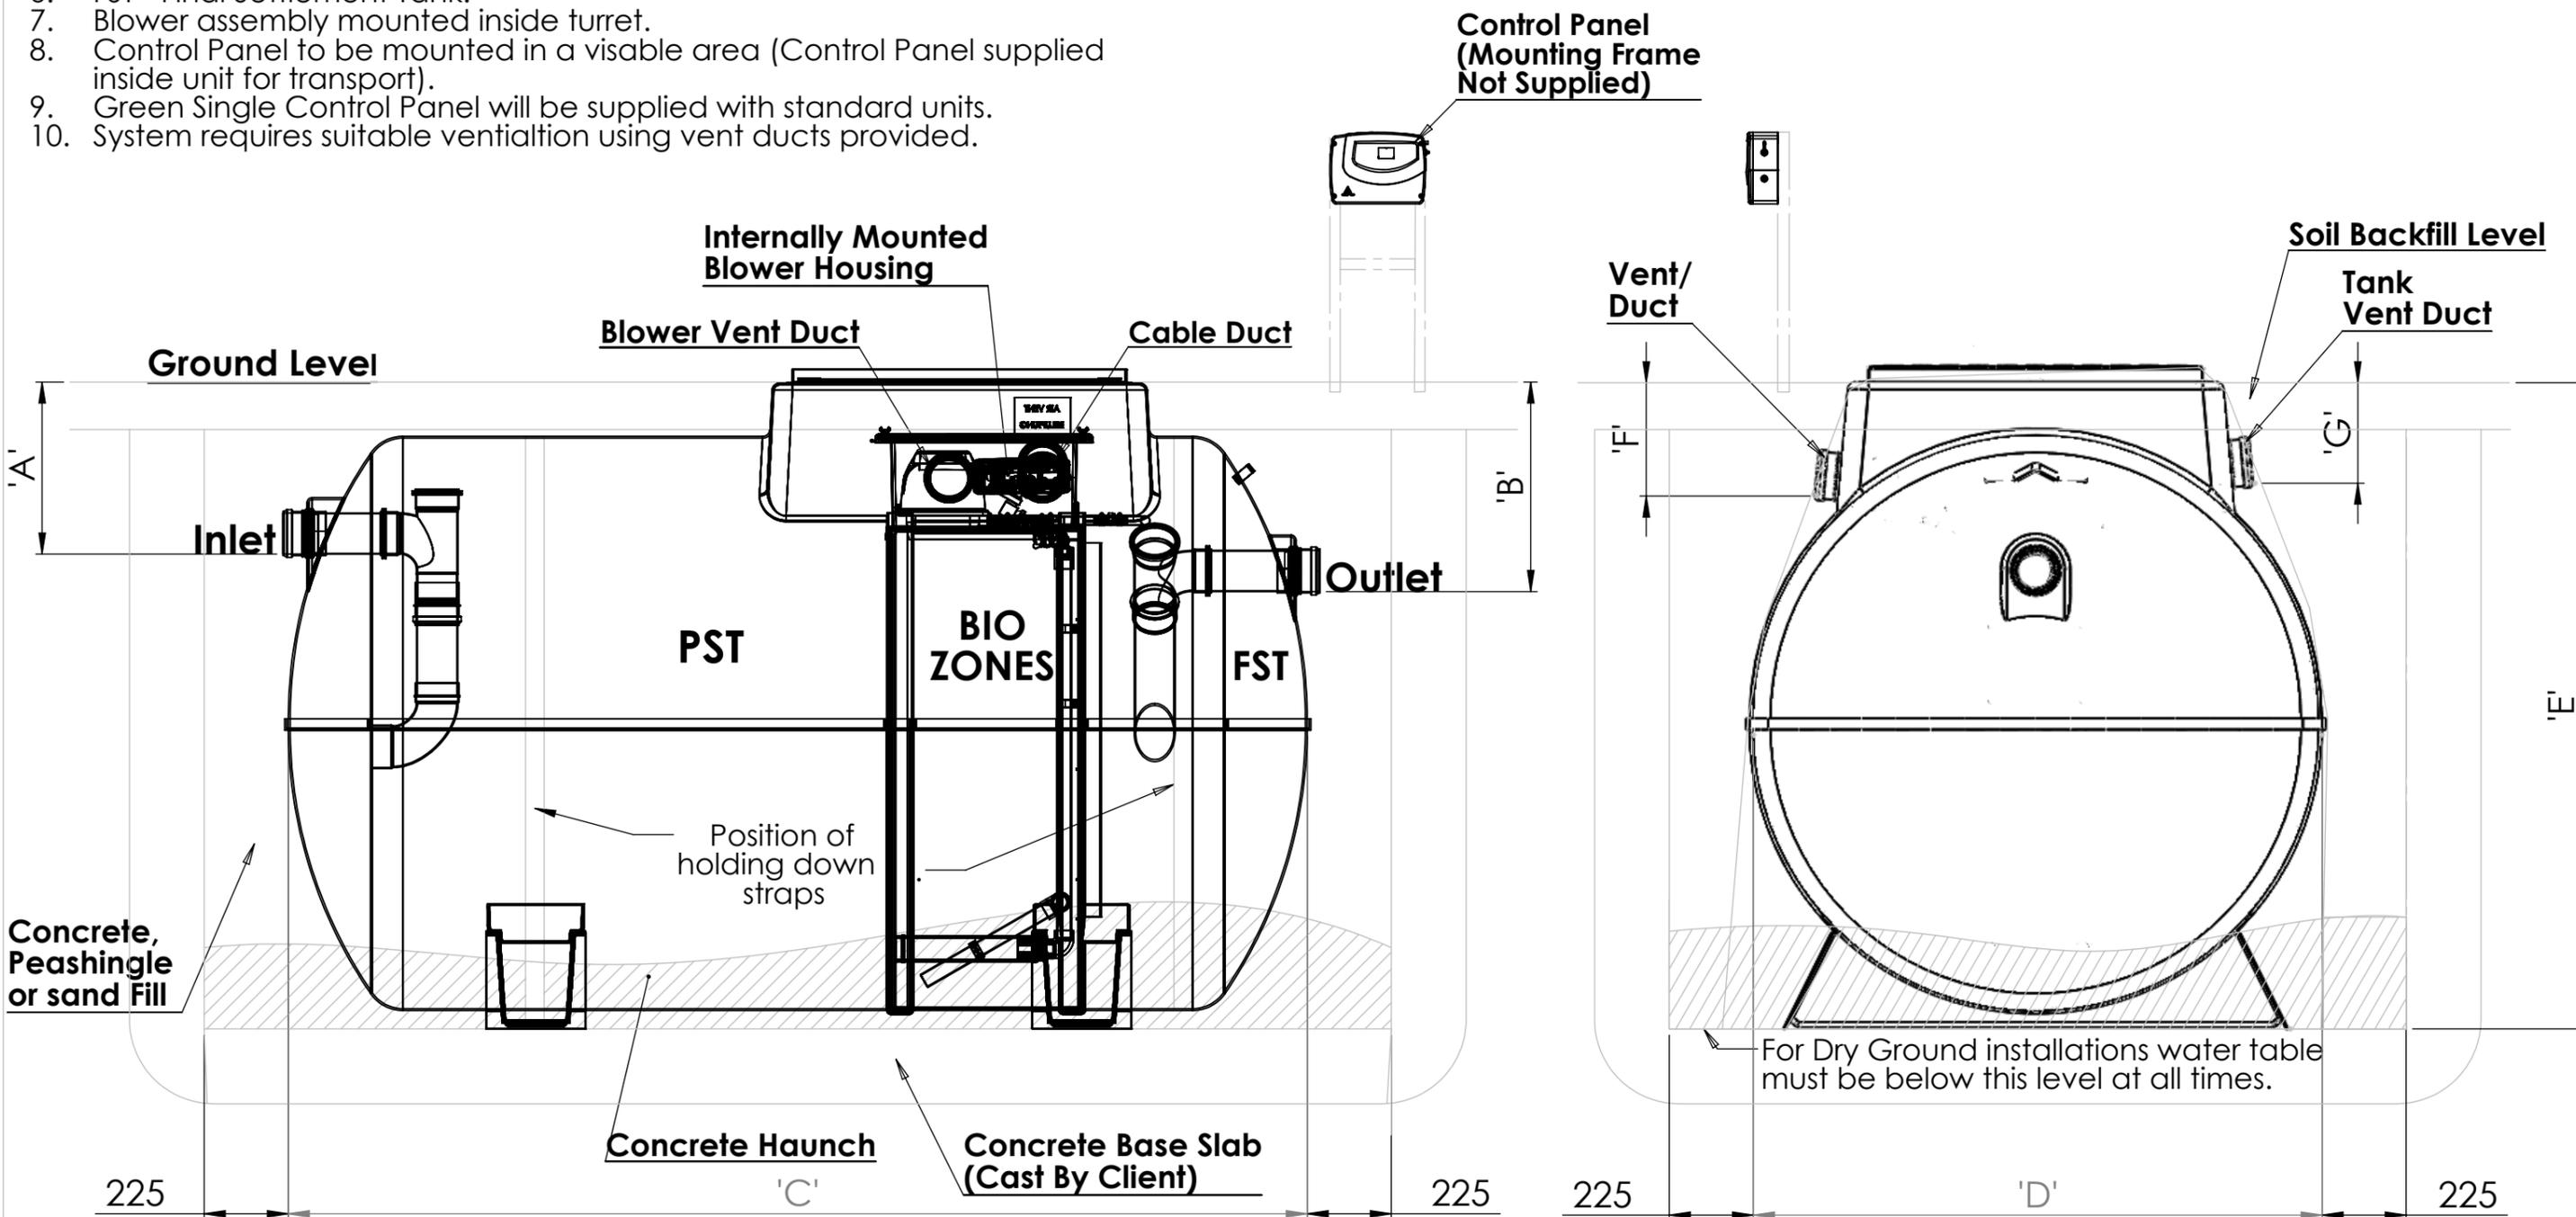

Please check with Clearwater that this drawing is the latest issue				
Issue	Date	Drawn by	Approved by	Description
01	03/10/14	M.H.		INITIAL ISSUE

Material : n/a
 Finish : n/a
 Weight : n/a Kgs
 Tolerance : n/a
 Thickness : n/a
 Surface Area : n/a

Drawing : DS0938B

Delta 1 Sales Drawing

All dimensions in mm

Scale: Not to scale

Clearwater reserve the right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without the written permission of Clearwater.

